


PLAN VIEW

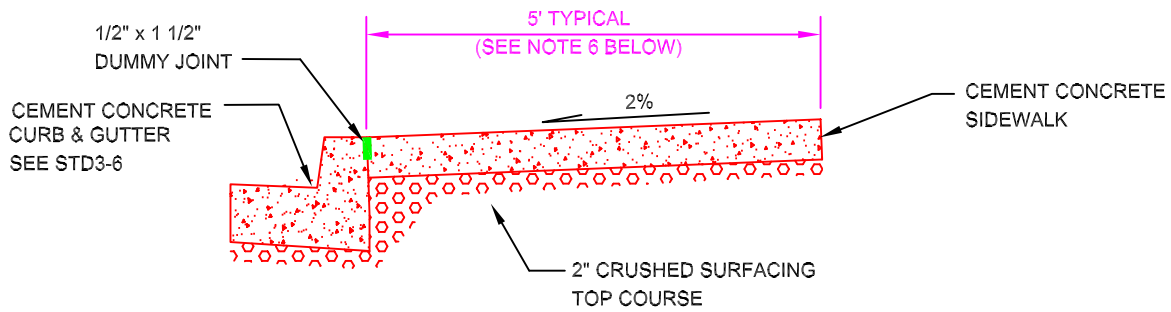

TYPICAL SECTION

NOTES

1. SIDEWALKS SHALL BE 4" THICK IN NON-TRAFFIC AREAS, 6" THICK IN TRAFFIC AREAS, AND SHALL BE 4000 PSI CONCRETE, WITH AIR ENTRAINMENT (MIN 4.5 %, MAX 6.5 %).
2. FULL DEPTH EXPANSION JOINTS SHALL GENERALLY BE PLACED TO MATCH THOSE PLACED IN ADJACENT CURB & GUTTER, WITH MAXIMUM SPACING OF 10 FEET. DUMMY JOINTS SHALL BE PLACED EVERY 5 FEET. FINAL SPACING DETERMINATION SHALL BE DECIDED BY THE INSPECTOR IN THE FIELD.
3. SUBGRADE SHALL BE COMPACTED AS SPECIFIED.
4. THE FINISHED SIDEWALK SHALL BE COVERED BY CURING COMPOUND, WATERPROOF PAPER OR PLASTIC SHEETING IN THE EVENT OF RAIN OR OTHER INCLEMENT WEATHER. CURING TIME SHALL BE AS SPECIFIED.
5. ALL JOINTS SHALL BE CLEANED AND EDGED WITH AN EDGER HAVING A 1/4" RADIUS.
6. SIDEWALKS ARE TYPICALLY 5' WIDE, EXCEPT 7' IN SOME COMMERCIAL AREAS, OR AS APPROVED BY THE PUBLIC WORKS DIRECTOR.

CEMENT CONCRETE SIDEWALK DETAILS

I:\STANDARD_PLANS\STD3-10.DWG



7-2007
date

3-10
number