



PLAN

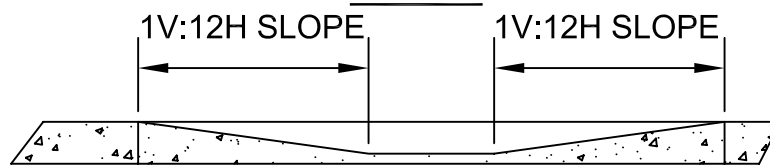

SECTION A-A

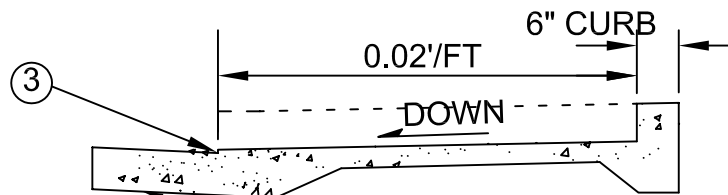

TYPE A CURB & GUTTER STD DETAIL 3-6

SECTION B-B

NOTES:

- ① RAMP TEXTURING SHALL BE A BROOM FINISH PERPENDICULAR TO THE DIRECTION OF TRAVEL
- ② 1/3 DEPTH EXPANSION JOINT.
- ③ NO LIP AT GUTTER LINE.
- ④ CURB RAMPS WILL NOT BE POURED INTEGRAL WITH SIDEWALK AND SHALL BE ISOLATED BY EXPANSION JOINT MATERIAL ON ALL SIDES.
- ⑤ TRUNCATED DOME PER ADA STANDARDS. TRUNCATED DOMES SHALL BE NON-CONCRETE, POLYMER, COMPOSITE, CAST IN PLACE UNITS COMPLIANT WITH ADA STANDARDS. COLOR SHALL BE UNIFORMLY INTEGRAL THROUGHOUT THE CROSS SECTION AND CONTRASTING COLOR WITH ADJACENT WALKWAY SURFACES PER ADA STANDARDS. SUBMIT SAMPLE TO CITY FOR APPROVAL PRIOR TO INSTALLATION.
- ⑥ POUR CURB SEPARATE FROM SIDEWALK POUR

TYPE D CURB RAMP



6-2006
date

3-15A
number